


Charlotte County Fire & EMS 5" Storz Connection Requirement

Effective immediately, Charlotte County Fire & EMS will now require 5" Storz connections in place of the 2 ½" siamese connection.

The following shall be required:

- 1) Shall be a 5" Storz connection.
- 2) Shall be located 30" above finish grade.
- 3) Shall have a 30-degree angle pattern.
- 4) Shall be within 100' of the fire hydrant.

This change will affect all newly permitted construction with Charlotte County Fire & EMS jurisdiction. A Storz connection will also be required on all repairs, replacements and/or remodels.

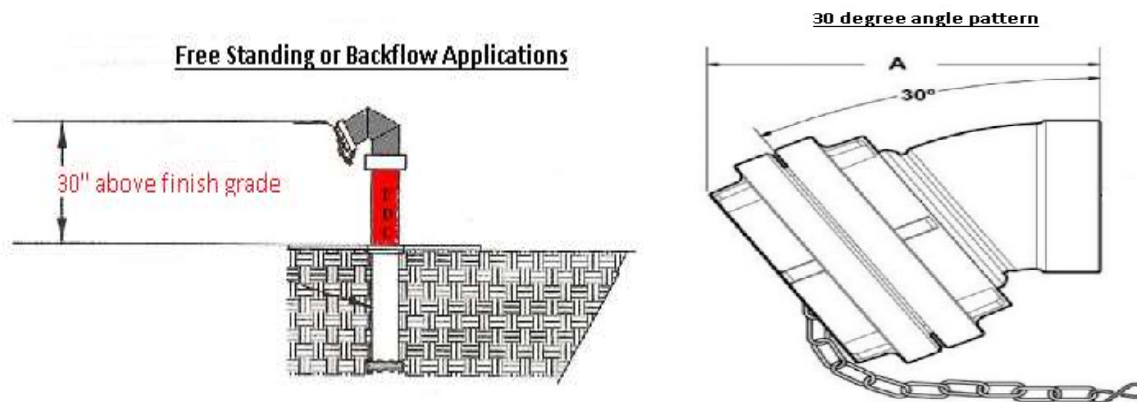

Scott P. Morris
Fire Marshal
Charlotte County Fire & EMS